

1. Installation and commissioning may only be carried out by authorised specialists and wired in accordance with the latest IEE electrical regulations or the national standards.
2. Mains power must be switched off before carrying out installation.
3. The manufacturer, shall not be liable for any damage resulting from inappropriate modifications to the luminaire or faulty installation.



4. Caution, risk of electric shock.  
The control gear provides basic insulation between the LV supply and the control circuit.



5. Luminaires not suitable for covering with thermally insulating material





You can help protect the environment!


Please remember to respect the local regulations: hand in non-working electrical equipment to an appropriate waste disposal centre. The packaging material is recyclable. Dispose of the packaging in an environmentally friendly manner and make it available for the recyclable material collection service.


Product Description	SAP Code	Wattage	Current	Voltage	PF	CRI	Ta	CCT
CIRCLINE 450 3800-940	96295124	32W	0.3A	220-240V	>0.95	>90	-15~+40°C	4000K

## Surface mount

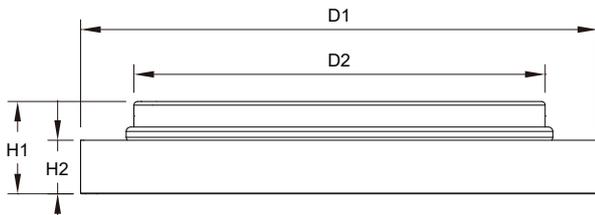


Dimension(mm)			
D1	D2	H1	H2
450	278	63	36.5

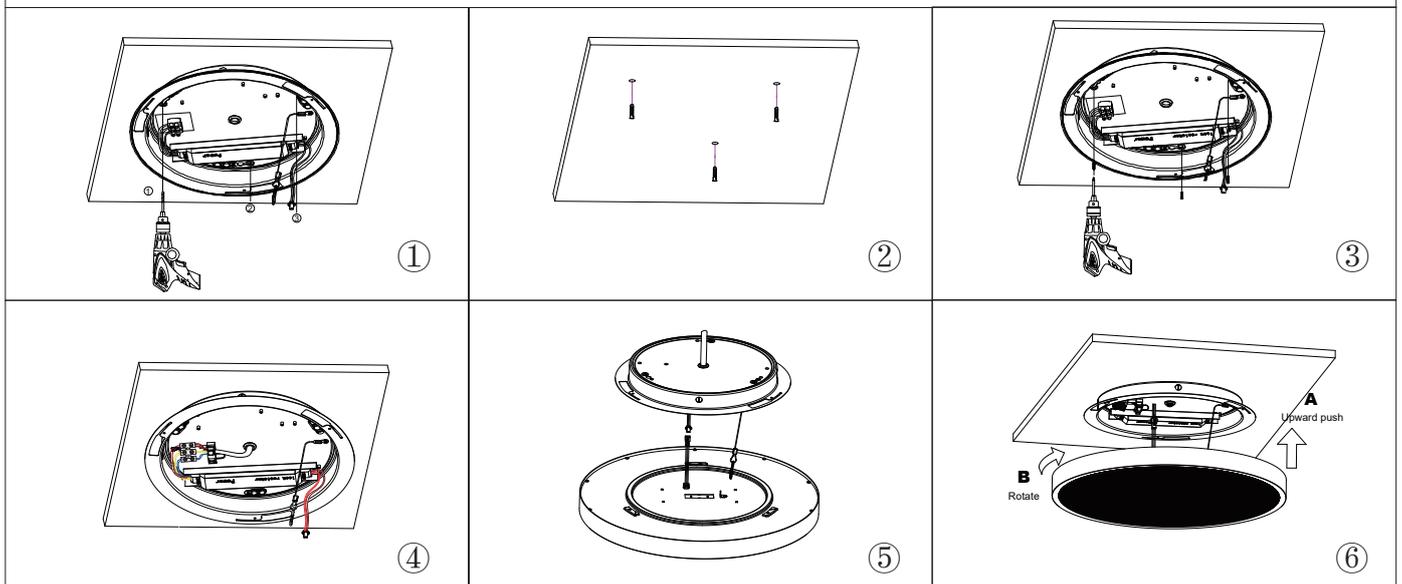


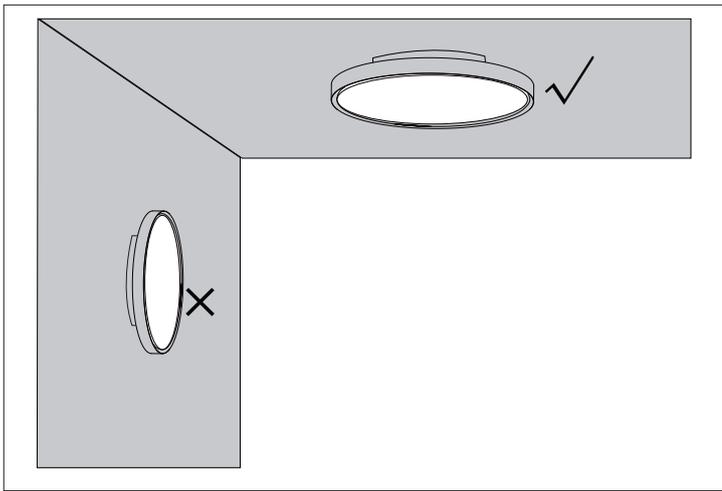


### Suspension installation

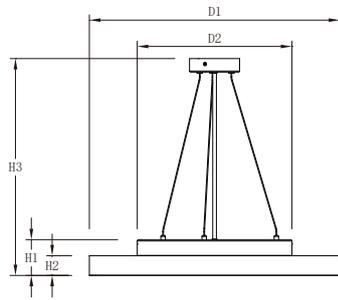

Dimension(mm)				
D1	D2	H1	H2	H3
450	278	63	36.5	1265

### Accessory pack

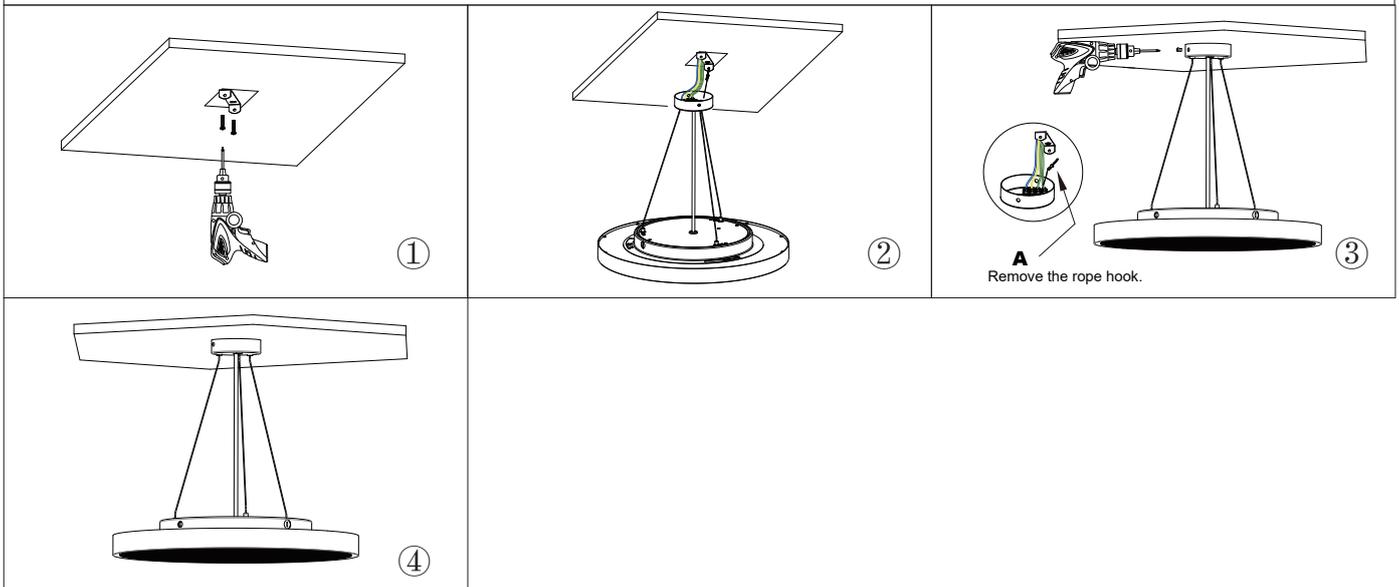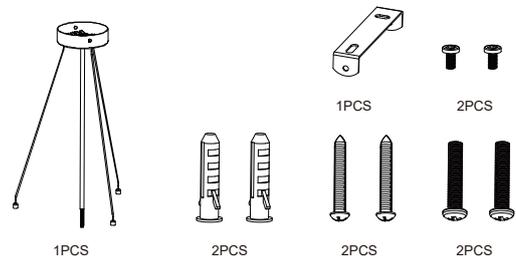

### Wiring

